




120 West Verbena Avenue
Foley, Alabama 36535
(251) 943-1266
Fax (251) 943-7432
www.cityoffoley.org

November 2025

Detailed Breakdown by Incident Type		
INCIDENT TYPE	# INCIDENTS	% of TOTAL
113 - Cooking fire, confined to container	1	0.41%
131 - Passenger vehicle fire	3	1.24%
137 - Camper or recreational vehicle (RV) fire	1	0.41%
151 - Outside rubbish, trash or waste fire	1	0.41%
311 - Medical assist, assist EMS crew	43	17.77%
322 - Motor vehicle accident with injuries	17	7.02%
323 - Motor vehicle/pedestrian accident (MV Ped)	2	0.83%
324 - Motor vehicle accident with no injuries.	35	14.46%
331 - Lock-in (if lock out , use 511)	1	0.41%
350 - Extrication, rescue, other	1	0.41%
353 - Removal of victim(s) from stalled elevator	1	0.41%
412 - Gas leak (natural gas or LPG)	1	0.41%
440 - Electrical wiring/equipment problem, other	1	0.41%
441 - Heat from short circuit (wiring), defective/worn	1	0.41%
445 - Arcing, shorted electrical equipment	1	0.41%
462 - Aircraft standby	7	2.89%
551 - Assist police or other governmental agency	1	0.41%
553 - Public service	1	0.41%
554 - Assist invalid	51	21.07%
561 - Unauthorized burning	5	2.07%
611 - Dispatched & cancelled en route	17	7.02%
622 - No incident found on arrival at dispatch address	6	2.48%
631 - Authorized controlled burning	5	2.07%
632 - Prescribed fire	1	0.41%
651 - Smoke scare, odor of smoke	6	2.48%
710 - Malicious, mischievous false call, other	1	0.41%
715 - Local alarm system, malicious false alarm	1	0.41%
733 - Smoke detector activation due to malfunction	1	0.41%
735 - Alarm system sounded due to malfunction	13	5.37%
736 - CO detector activation due to malfunction	1	0.41%
740 - Unintentional transmission of alarm, other	1	0.41%
741 - Sprinkler activation, no fire - unintentional	1	0.41%
743 - Smoke detector activation, no fire - unintentional	7	2.89%
744 - Detector activation, no fire - unintentional	1	0.41%
745 - Alarm system activation, no fire - unintentional	4	1.65%
746 - Carbon monoxide detector activation, no CO	1	0.41%
TOTAL INCIDENTS:	242	100%



120 West Verbena Avenue
 Foley, Alabama 36535
 (251) 943-1266
 Fax (251) 943-7432
www.cityoffoley.org

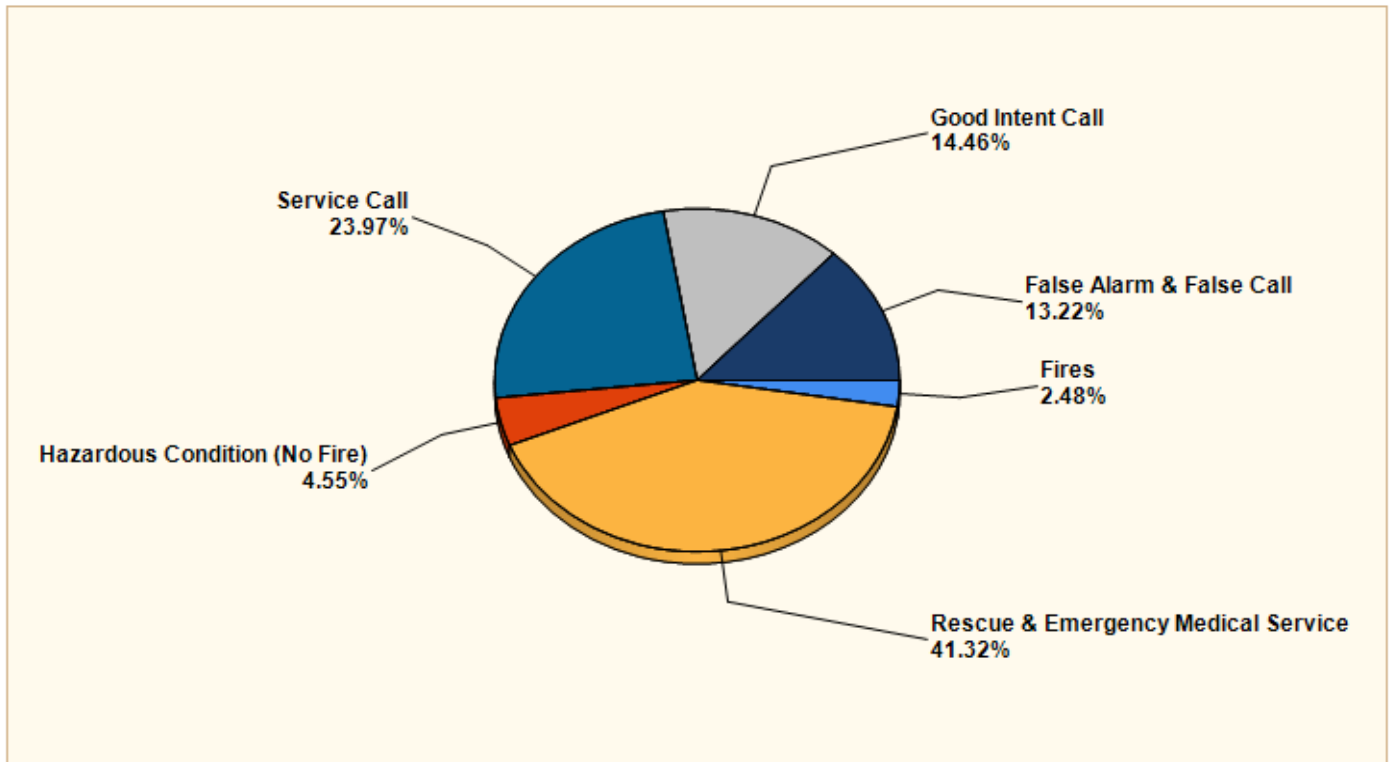


MAJOR INCIDENT TYPE	# INCIDENTS	% of TOTAL
Fires	6	2.48%
Rescue & Emergency Medical Service	100	41.32%
Hazardous Condition (No Fire)	11	4.55%
Service Call	58	23.97%
Good Intent Call	35	14.46%
False Alarm & False Call	32	13.22%
TOTAL	242	100%



120 West Verbena Avenue
Foley, Alabama 36535
(251) 943-1266
Fax (251) 943-7432
www.cityoffoley.org

Incident Trend

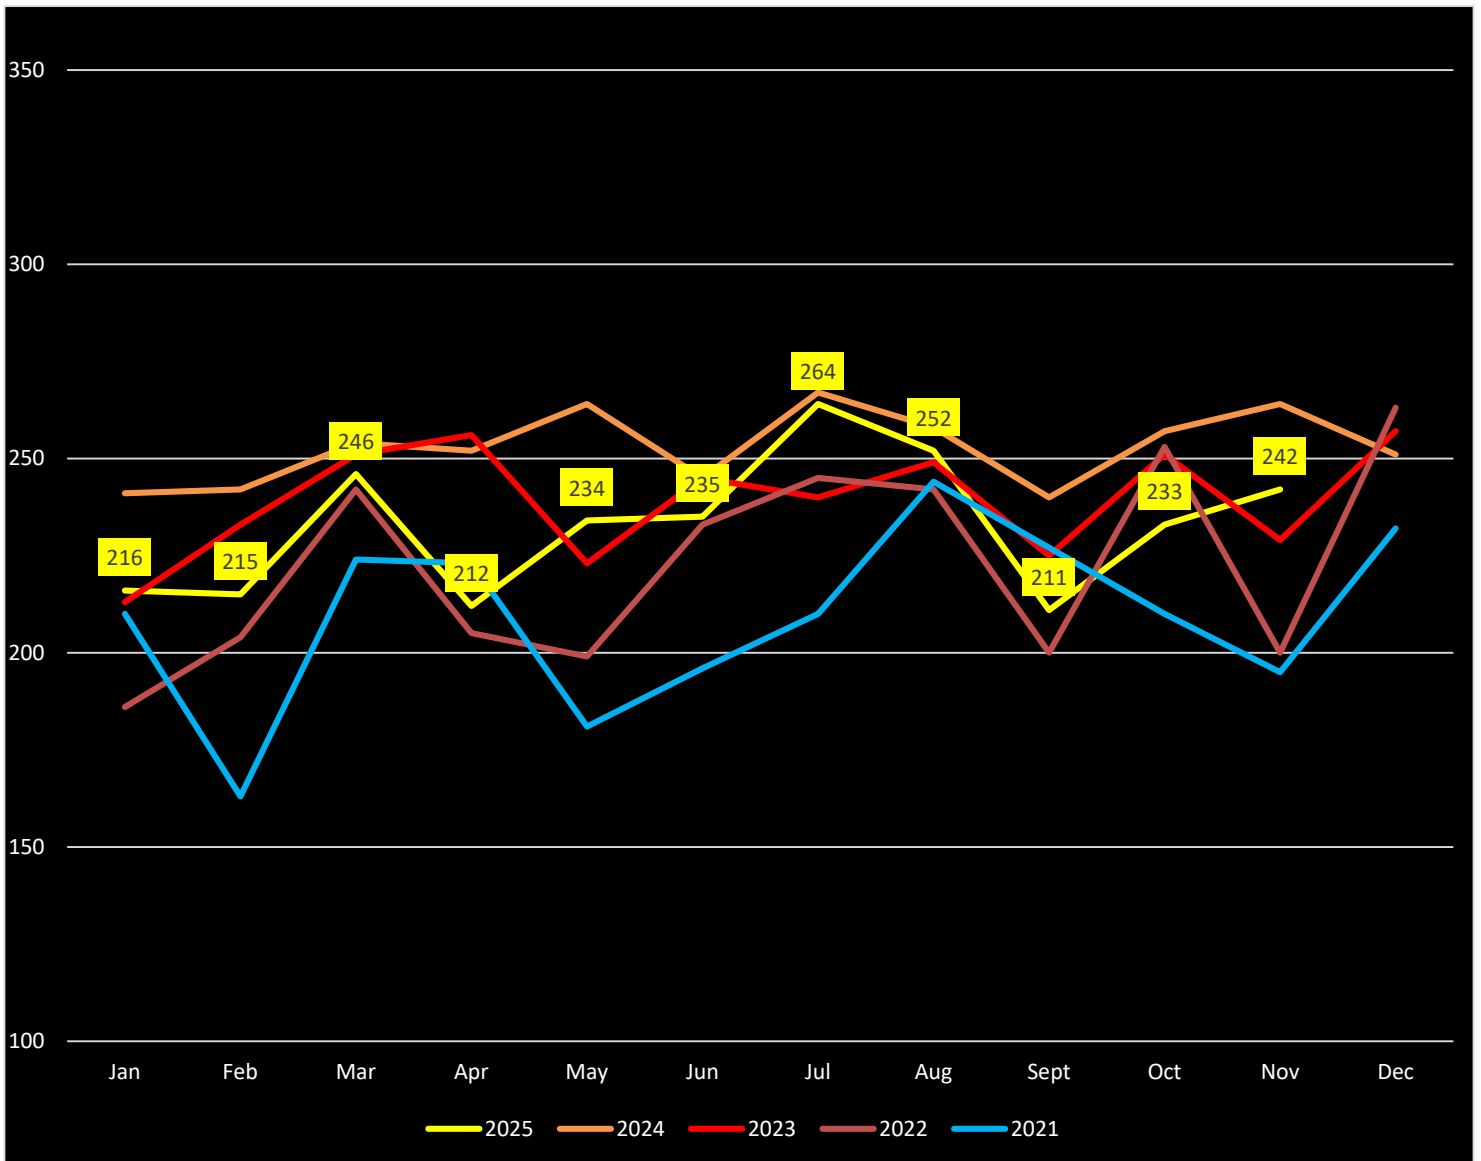



120 West Verbena Avenue
Foley, Alabama 36535
(251) 943-1266
Fax (251) 943-7432
www.cityoffoley.org

Public Education / Public Relations

Citizens trained in **CPR**: 81 Adults

11/01 Truck Display – Tractor Supply: 10 Adults, 5 Children
11/01 Truck Display – Pirates Cove RV: 10 Adults, 15 Children
11/04 Smoke Alarm detail – 18229 Millspring Dr.: 1 Adult
11/11 Station Tour – St.1: 3 Adults, 15 Children
11/11 Veteran's Day Parade
11/12 Smoke Alarm detail – 18958 Isleworth Way: 1 Adult
11/12 Smoke Alarm detail – 656 Parish Lakes Dr.: 1 Adult
11/13 Smoke Alarm detail – 1760 N. Juniper St.: 1 Adult
11/14 Truck display / Safety talk – Heavenly Sent Daycare: 2 Adults, 25 Children
11/14 Station Tour – St.1: 2 Adults, 3 Children
11/17 Smoke Alarm detail – 1117 Yellow Daisy Ln.: 1 Adult
11/19 Station Tour – St.1: 1 Adult, 1 Child
11/20 Smoke Alarm detail – 22374 Hibiscus Cir.: 1 Adult
11/20 Smoke Alarm detail – 14997 Troon Dr.: 1 Adult
11/24 Smoke Alarm detail – 211 W. Satsuma Ave.: 1 Adult
11/24 Station Tour – St.1: 2 Adults, 4 Children
11/24 Station Tour – St.1: 1 Adult, 3 Children
11/25 Blood Pressure Checks – Foley Senior Center: 25 Adults
11/25 Fire Safety Talk – Foley Senior Center: 75 Adults
11/29 Station Tour – St.1: 2 Adults, 1 Child
11/29 Station Tour – St.1: 2 Adults, 1 Child

Total Contacts: 297



120 West Verbena Avenue
 Foley, Alabama 36535
 (251) 943-1266
 Fax (251) 943-7432
www.cityoffoley.org

Inspections

	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	2025 Totals
Plan Review													
Commercial	51	64	52	49	49	47	55	34	46	50	42	0	539
Multi-Family	1	5	0	5	0	0	4	1	0	0	0	0	16
Subdivisions	0	2	2	0	1	4	5	1	0	0	0	0	15
Public Contacts/Meetings													
	428	648	644	549	536	487	581	500	405	642	402	0	5822
New Construction Insp													
Assembly	14	16	15	4	3	16	10	10	0	0	1	0	89
Business	16	16	13	13	26	13	11	32	44	17	19	0	220
Education	0	0	0	1	0	0	2	0	0	0	0	0	3
Factory	0	1	0	0	1	0	0	0	2	0	0	0	4
Institutional	0	0	0	0	0	0	0	0	0	3	0	0	3
Mercantile	11	4	5	6	10	11	1	7	0	0	0	0	55
Residential Single	1	5	3	3	2	5	8	1	1	2	2	0	33
Residential Multi	1	12	3	9	6	8	11	1	0	0	0	0	51
Total New	43	54	39	36	48	53	43	51	47	22	22	0	458
Existing Occupancy Insp													
Assembly	20	114	45	52	27	21	11	20	3	39	30	0	0
Business	41	14	22	38	88	40	124	43	33	92	34	0	569
Education	0	0	0	0	1	3	4	2	1	5	0	0	16
Factory	2	0	0	0	0	0	0	0	0	2	0	0	4
Institutional	0	0	0	0	0	0	0	0	0	0	1	0	1
Mercantile	19	6	9	18	18	21	23	84	52	76	30	0	356
Residential Single	0	0	0	0	0	0	0	1	1	4	2	0	8
Residential Multi	0	30	66	47	0	18	2	0	4	8	19	0	194
Total Existing	82	164	142	155	134	103	164	150	94	226	116	0	1530
TOTAL INSPECTIONS	125	218	181	191	182	156	207	201	141	248	138	0	1988